


**PROPOSED PLAN**


SCALE 1:100

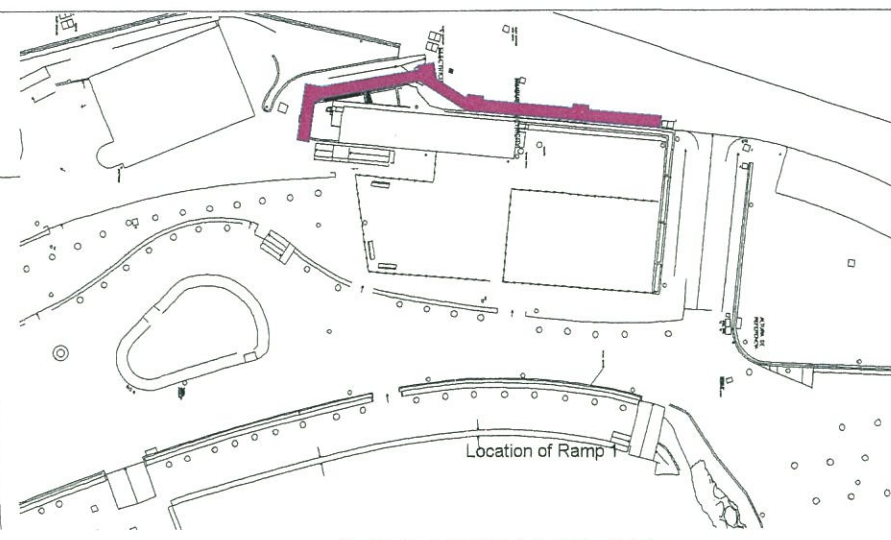

**LOCATION PLAN**


N.T.S

- Notes**
1. CONCRETE TO BE GRADE 35 DESIGNED MIX FOR ORDINARY STRUCTURAL CONCRETE IN ACCORDANCE WITH B.S. 8110:1985
  2. CONCRETE TO BE MECHANICALLY VIBRATED.
  3. ALL CONCRETE SURFACE TO FREE FROM VOIDS, HONEYCOMBING AND OTHER BLEMISHES.
  4. CONCRETE COVER TO ALL REINFORCEMENT TO BE 40MM UNLESS OTHERWISE STATED.
  5. POSITION OF CONSTRUCTION JOINTS TO BE AGREED WITH THE ENGINEER ON SITE.
  6. ALL REINFORCED CONCRETE STRUCTURAL MEMBERS TO BE ADEQUATELY CURED AND PROTECTED.
  7. THE ENGINEER RESERVES RIGHT TO REQUIRE ANY CONCRETE THAT DOES NOT COMPLY WITH THE REQUIREMENTS OF THE SPECIFICATION TO BE ENTIRELY DEMOLISHED AND RECONSTRUCTED AT THE CONTRACTORS EXPENSE.
  8. MAIN REINFORCEMENT TO BE COLD WORKED TYPE 2 BARS COMPLYING WITH B.S. 4449:1985 AND BENT IN ACCORDANCE WITH B.S. 4466:1985.
  9. FABRIC MESH REINFORCEMENT SHEETS TO COMPLY WITH B.S. 4463:1985 AND TO BE CUT ON SITE.
  10. MINIMUM LAPS BETWEEN FABRIC MESH REINFORCEMENT SHEETS TO BE 300mm.
  11. HARDWARE TO BE 150mm MIN. THICKNESS & TO BE WELL COMPACTED FOR MAXIMUM CONSOLIDATION.
  12. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THE STABILITY OF THE SITE AND WORKS, INCLUDING ADJOINING SITES AND WORKS, AND ALL SERVICES THROUGHOUT THE CONSTRUCTION.
  13. ALL THE EXCAVATIONS AND THE SURROUNDING SITE TO BE KEPT FREE OF WATER.
  14. THE GROUND BELOW R.C. FOUNDATIONS TO BE BLINDED WITH 50mm THICK LAYER OF CONCRETE AND FOUNDATIONS TO BE CAST WITHOUT DELAY FOLLOWING EXCAVATION TO FORMATION LEVELS AND APPROVAL OF THE BEARING STRATUM.
  15. THE DESIGN OF THE FOUNDATIONS IS BASED ON THE ASSUMPTION THAT THE SOIL AT FORMATION LEVEL CAN SAFELY SUSTAIN A BEARING PRESSURE OF 200KPa. ANY POCKETS OF WEAKER SOIL FOUND AT THIS LEVEL SHALL BE EXCAVATED AND THE LEVELS UP WITH MASS CONCRETE.
  16. THE ENGINEERS APPROVAL MUST BE OBTAINED PRIOR TO ALTERING THE FORMATION LEVELS SHOWN ON THE DRAWINGS.
  17. FILL MATERIAL TO BE DEPOSITED IN LAYERS 200mm THICK AND TO BE WELL COMPACTED FOR MAXIMUM CONSOLIDATION.
- STEEL WORK:**
18. ALL WELDS TO BE CONTINUOUS UNLESS OTHERWISE STATED.
  19. THE CONTRACTOR IS RESPONSIBLE FOR THE CORRECT SETTING OUT OF THE WORKS ON SITE AND ALSO FOR REFERRING ANY DIMENSIONAL DISCREPANCIES TO THE S.O. PRIOR TO ANY ACTION BEING TAKEN.
  20. THE CONTRACTOR IS RESPONSIBLE FOR THE STABILITY OF THE BUILDING DURING THE CONSTRUCTION PERIOD.
  21. ALL STRUCTURAL STEEL TO BE GRADE 43A B.S. 4360.
  22. ALL DIMENSIONS MUST BE CHECKED ON SITE AND NOT SCALED FROM THIS DRAWING.
  23. FIRE EXIT SIGN TO BS 5489 PART 4.




**SECTION A-A**

SCALE 1:100

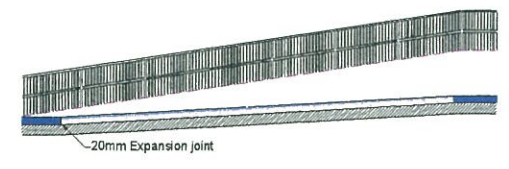


**SECTION B-B**

SCALE 1:100

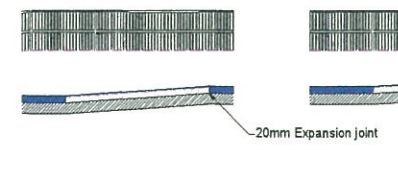


**SECTION C-C**

SCALE 1:100

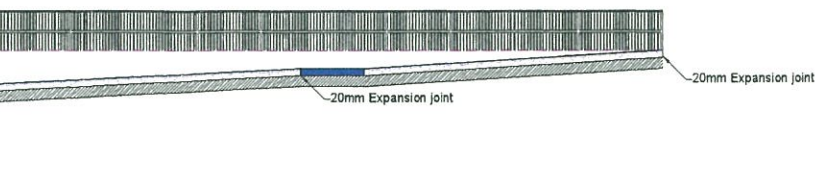


**SECTION D-D**

SCALE 1:100

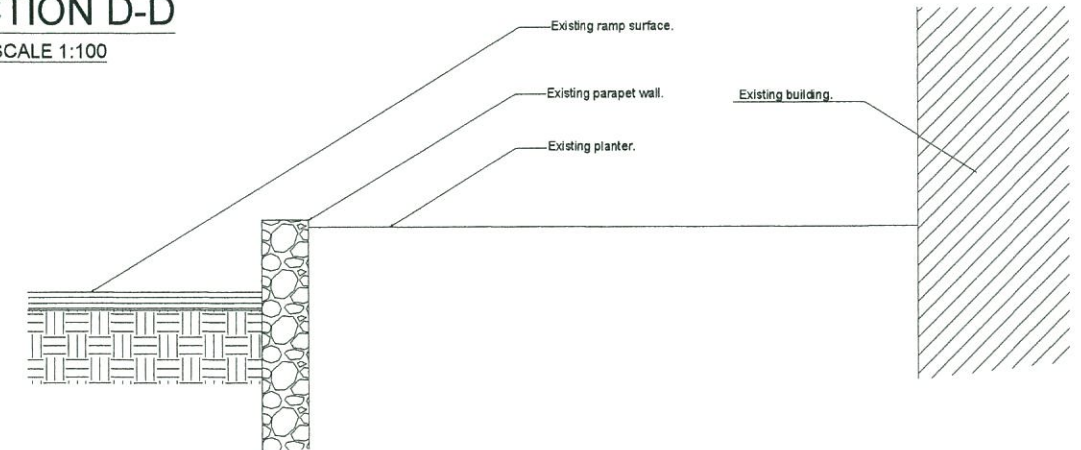


**EXISTING SECTION Y-Y**

SCALE 1:20

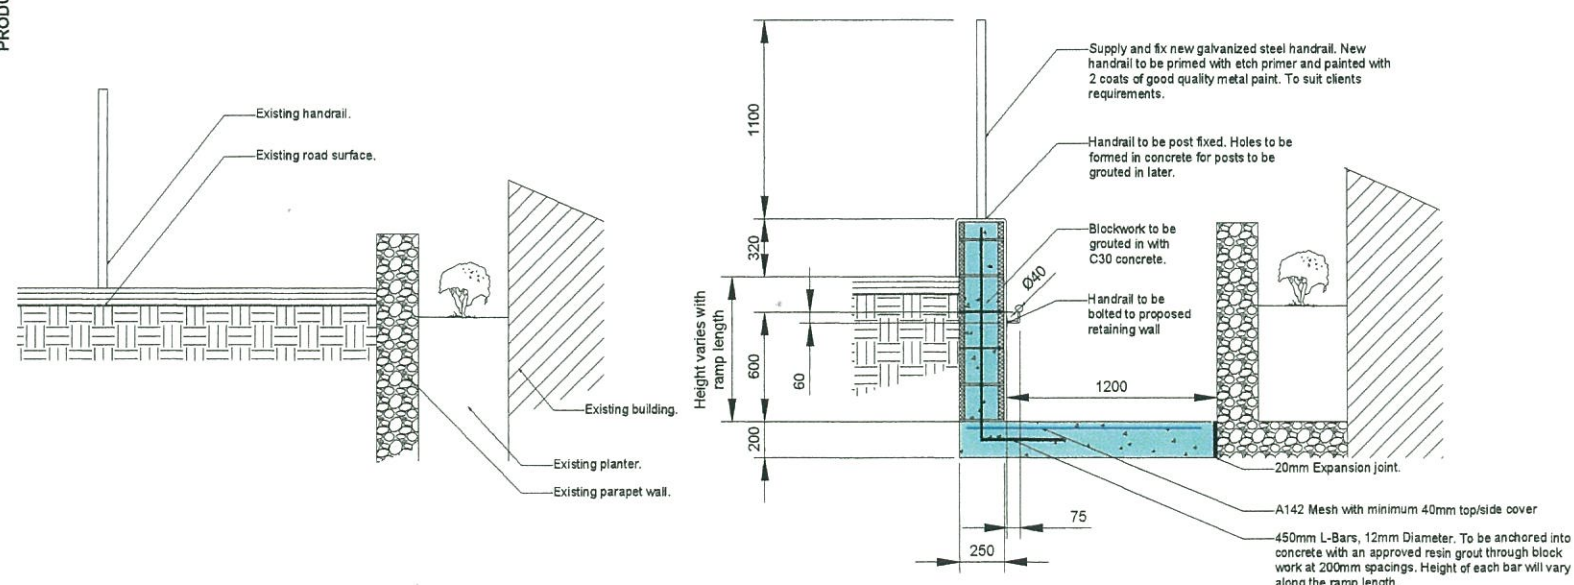

**EXISTING AND PROPOSED SECTION X-X**

SCALE 1:20

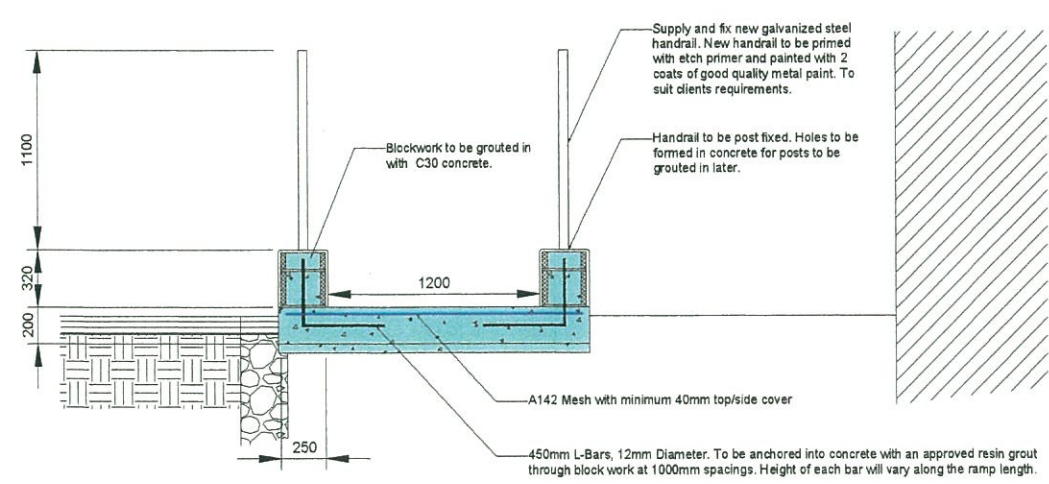

**PROPOSED SECTION Y-Y**

SCALE 1:20

A	Date	Revision

H.M Government of Gibraltar  
 Technical Services Department  
 Joshua Hassan House  
 Secretary's Lane  
 Gibraltar

Job Title 06 JUN 2013

Camp Bay Ramps  
**RECEIVED**

**DRAWING TITLE**  
 Ramp 1  
 Site Layout and  
 Elevation

Scale As Shown  
 Date 04.05.2013 Drawn by J. RUSSO

Dr. No. 88/122 Rev.